No part of this drawing may be reproduced or utilized in any form or by any means electronic and mechanical, including photocopying and microfilm, without permission in writing from the authority of ENERGO - GROUP

Crtez ili dio ovog crteza ne moze biti reprodukovan ili koristen u bilo kojoj formi ili na bilo koji nacin, elektronski ili mehanicki, ukljucujuci fotokopiranje i mikrofilm, bez pismenog odobrenja ENERGO-GROUP

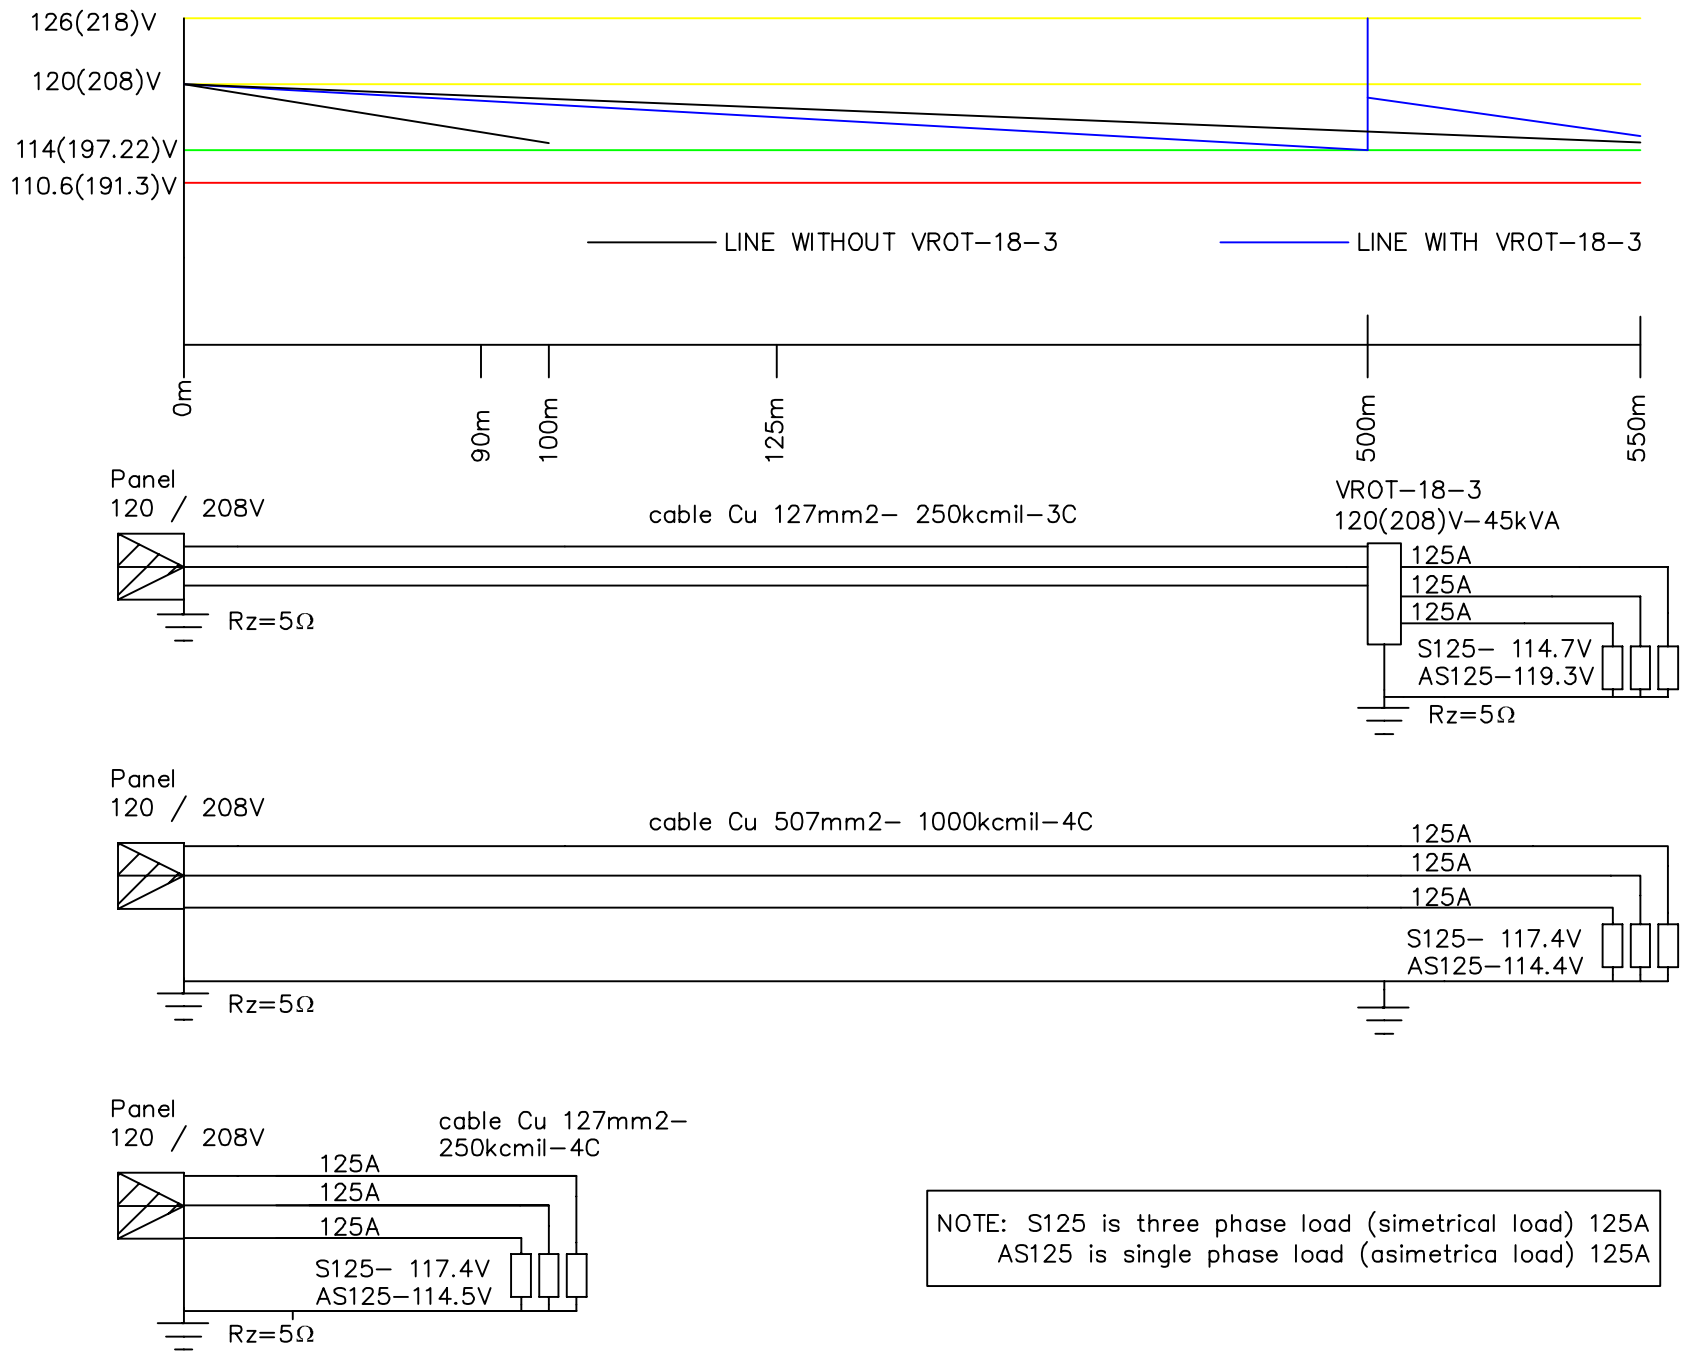

NOTE: S125 is three phase load (simetrical load) 125A
AS125 is single phase load (asimetrica load) 125A

Tested by		Drawn	Z.BABIC				ENERGO - GROUP I.SARAJEVO ENGINEERING DIVISION Electrical project department	VROT 18-3	0
As ecected		Checked by	B.LALIC	REVISION	DESCRIPTION	DATE			
CHANGED WITH		Standardised	A.LEMEZ					VOLTAGE 120(208)V	EG.7000/10
CHANGED BY		P=	M: 1:1	BOOK No	COPY No	ENCLOSURE No			SHEETS 4 SHEET 3